

INSTALLATION INSTRUCTIONS

1. SERIAL NUMBER

There is a barcode serial number on the bottom of “puck” and on the product box. When calling to talk about your product, please have this number handy.



PRODUCT CODE YEAR MADE SERIAL NUMBER


4. CONNECT TO GATE

CP-4 works with all gate operators—powered or solar. Connect wires as follows:

POWER GATES	SOLAR GATES
RED → POWER +	RED → POWER +
BLACK → POWER -	BLACK] → GND or COM
WHITE → COMMON	WHITE] → GND or COM
BLUE → EXIT N.O.	BLUE → FREE EXIT or OPEN TERMINAL
YELLOW → EXIT N.C.	

VOLTAGE	CURRENT
8-24 VAC	Standby: 30-70 μ A
8-30 VDC	Alarm: 40-60 mA

2. TRENCH PIPE & CABLE

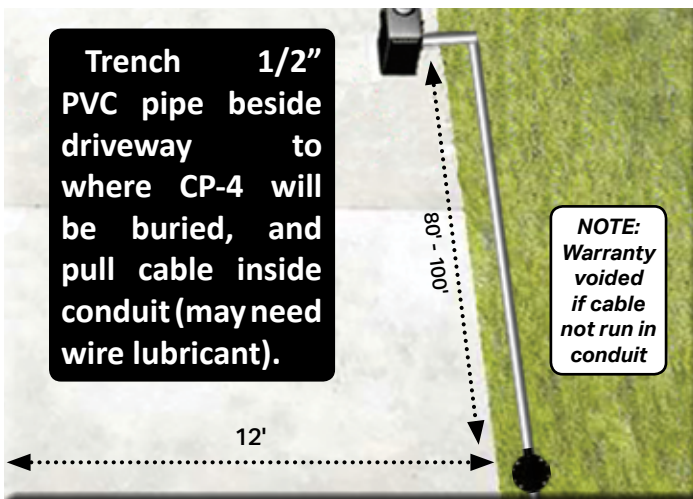

5. TEST SENSITIVITY

NOTE: IN MOST CASES SENSITIVITY WILL NOT NEED TO BE ADJUSTED.

SENSITIVITY ADJUSTMENT	
HIGH (Default) Detects vehicle 12-14' 1 & 2 in OFF position	
MEDIUM Detects vehicle 6-8' 1 ON & 2 OFF position	
LOW Detects vehicle 2-3' 1 & 2 in ON position	


Note: Dip switch color may vary

3. CONDUIT & SLIP JOINT



After pulling cable through plastic conduit, insert conduit inside slip joint on “puck.”
DO NOT GLUE (to un-install later, if needed).

6. BURY CONDUIT & “PUCK”

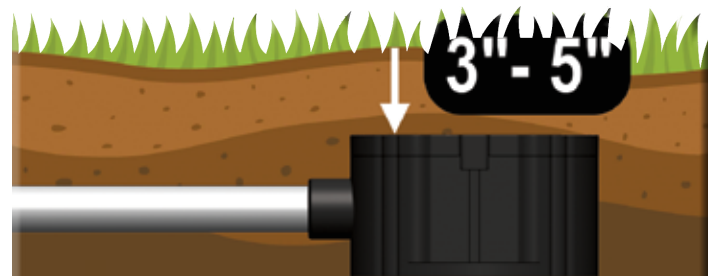

Test unit with gate by swinging steel over puck (or driving vehicle by). If it opens the gate correctly, finish installation by burying conduit and puck 3-5” below surface.

OTHER INSTRUCTIONS

- CP-4 may be installed above ground by screwing “puck” directly to post or building
- If above ground, make sure puck is immovable to eliminate false alarms
- If installed above ground, conduit is required to mechanically protect cable (animals will eat)

Install CP-4 at least:

- 6-10 feet away from buried power, telephone, or invisible dog fence
- 10 feet away from natural gas lines
- 20 feet away from power pole with a transformer
- 100 feet back from railroad traffic
- 200 feet away from high power substation power lines
- 80-100 feet back from gate operator

Technical Specifications	
Power Required	8–24 VAC or 8–30 VDC
Stand-By Current	30–70 Microamps (µA)
Alarm Current	30–40 Milliamps (mA)
Relay Time	2–3 seconds
Relay Contacts	SPDT, floating, N.O. or N.C. (Form C)
Relay Contact Rating	1 amp/24 VDC (1 mA at 5 VDC min. load)
Enclosure Rating	IP67
Strength Rating	9.53 ton-force 8646 kgf
Temperature Range	-25° F. – +140° F. -32° C. – 60° C.
Dimensions	4.5 in. dia. x 2.5 in. high
Weight	5 lbs. with 100 ft. cable

RETURNING MERCHANDISE

CONSUMER: Contact us at (800) 878-7829

INSTALLER: CALL BEFORE DIGGING UP

Call us to troubleshoot and receive a Return Merchandise Authorization (R.M.A.) number. Write R.M.A. number on return shipping box and any correspondence included with defective product.

5 YEAR WARRANTY

All Cartell products are warranted against defects in material and workmanship for five years.

This warranty does not cover defects caused by, but not limited to: acts of God, improper installation, abuse, fire damage, electrical surges, and damage to cable caused by slicing, pulling, tangling, improper splicing or not running in non-metallic conduit.



cartell[®]



The CP-4 complies with part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.